


DIKING DISTRICTS PRIOR TO CONSOLIDATION

NOTE: BOUNDARY LINES ARE APPROXIMATE ONLY, CHECK INDIVIDUAL LEGAL DESCRIPTIONS FOR ACCURATE LOCATIONS.

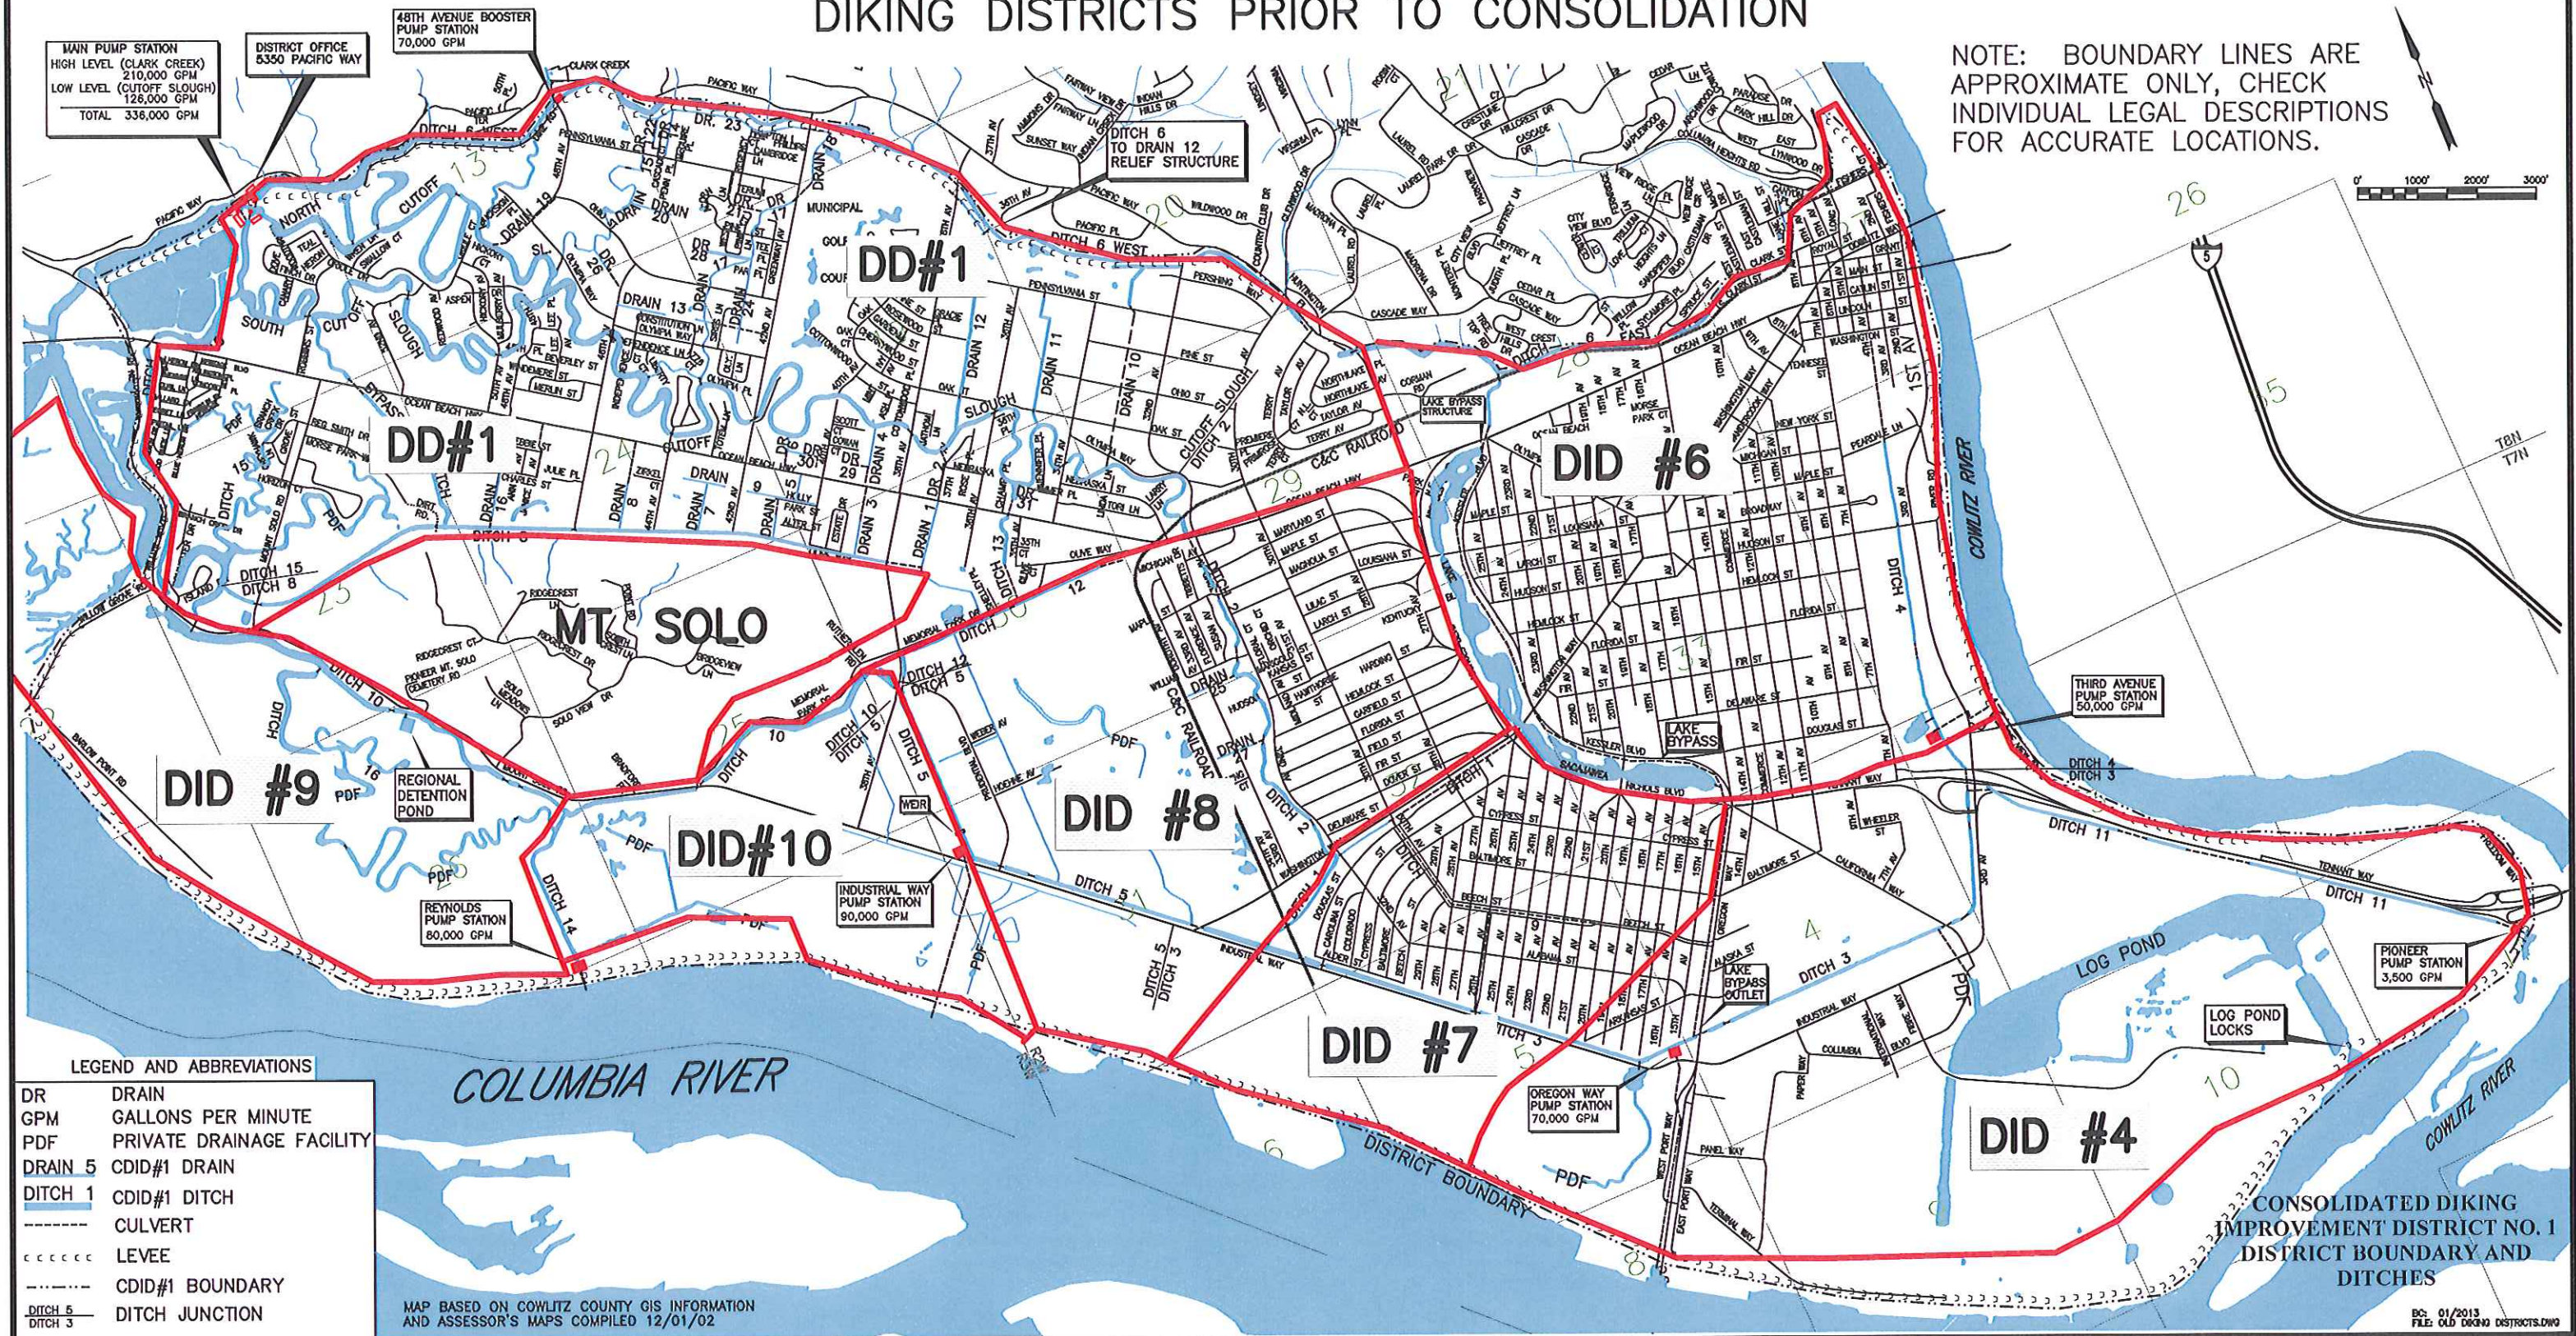

MAIN PUMP STATION
HIGH LEVEL (CLARK CREEK)
210,000 GPM
LOW LEVEL (CUTOFF SLOUGH)
126,000 GPM
TOTAL 336,000 GPM

DISTRICT OFFICE
5350 PACIFIC WAY

48TH AVENUE BOOSTER
PUMP STATION
70,000 GPM

DITCH 6
TO DRAIN 12
RELIEF STRUCTURE

THIRD AVENUE
PUMP STATION
50,000 GPM

REGIONAL
DETENTION
POND

INDUSTRIAL WAY
PUMP STATION
90,000 GPM

OREGON WAY
PUMP STATION
70,000 GPM

PIONEER
PUMP STATION
3,500 GPM

LEGEND AND ABBREVIATIONS

DR	DRAIN
GPM	GALLONS PER MINUTE
PDF	PRIVATE DRAINAGE FACILITY
DRAIN 5	CDID#1 DRAIN
DITCH 1	CDID#1 DITCH
---	CULVERT
-----	LEVEE
-----	CDID#1 BOUNDARY
DITCH 5 DITCH 3	DITCH JUNCTION

MAP BASED ON COWLITZ COUNTY GIS INFORMATION
AND ASSESSOR'S MAPS COMPILED 12/01/02

CONSOLIDATED DIKING
IMPROVEMENT DISTRICT NO. 1
DISTRICT BOUNDARY AND
DITCHES